


- (B) the default clearances as specified in Figure 4.7, which may require a barrier or guard constructed of fire-resistant materials.

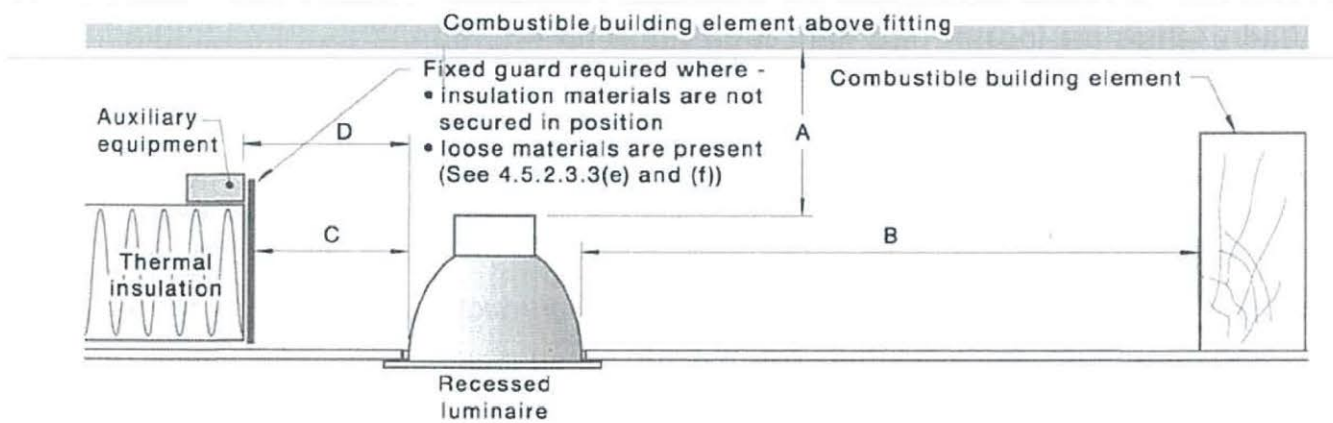

Dimension	Clearance
A – Clearance above luminaire	200 mm
B – Side clearance to combustible building element	200 mm
C – Side clearance to bulk thermal insulation	50 mm
D – Clearance to auxiliary equipment (transformer for example)	50 mm

FIGURE 4.7 DEFAULT MINIMUM CLEARANCES FOR RECESSED LUMINAIRES

4.5.2.3.2 Warning sign

Where recessed luminaires are installed in an accessible roof space, a permanent and legible warning sign shall be installed in the roof space adjacent to the access panel, in a position that is visible to a person entering the space. The sign shall comply with AS 1319 and contain the words shown in Figure 4.8 with a minimum size of lettering of 10 mm.



FIGURE 4.8 WARNING SIGN TO BE INSTALLED IN ACCESSIBLE ROOF SPACES CONTAINING RECESSED LUMINAIRES